




# Test Procedure for the STK433-040NGEVB Evaluation Board


## Characteristics confirmation

### [Connection Diagram]

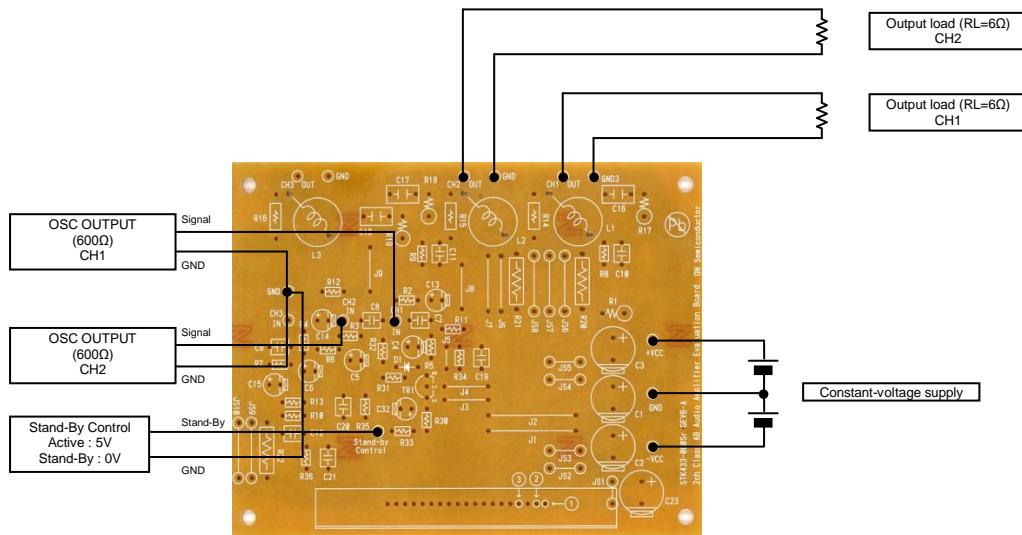

## Sound quality confirmation, load short-circuit test, noise examination

### [Connection Diagram]

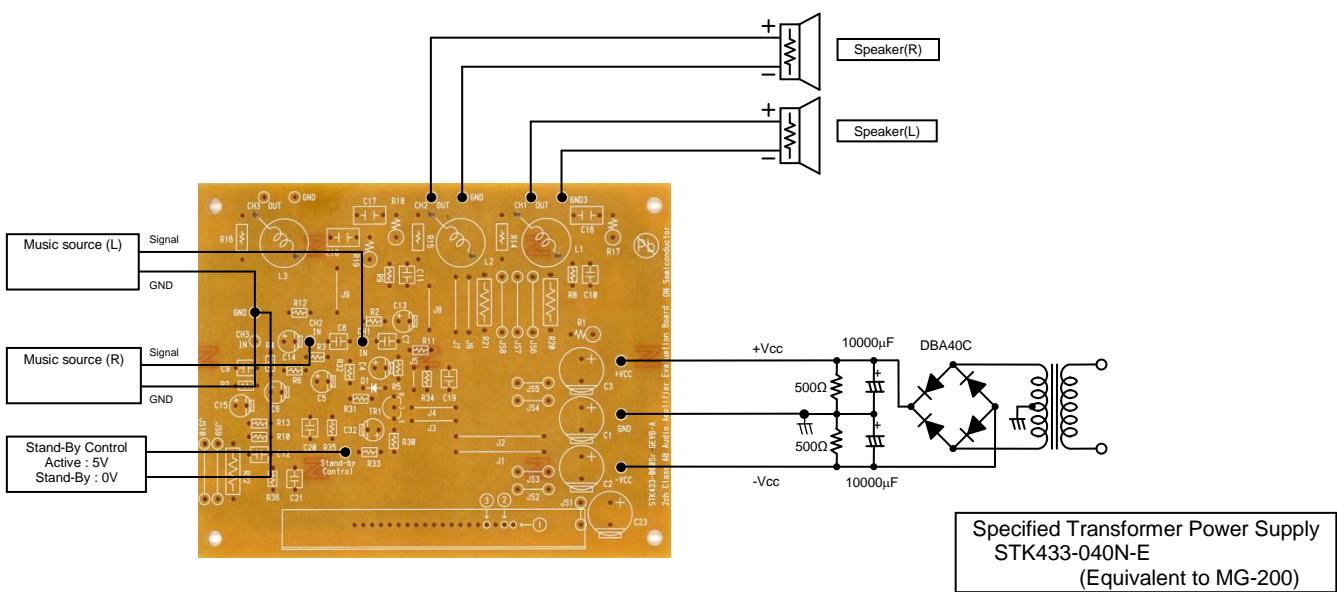



## [Required Equipment]

Equipment	Efficiency
Power supply +Vcc	50V-5A
Power supply -Vcc	50V-5A
Power supply Stand-By Control	10V-1A
Load	60Ω (Non-inductive load)
Measurement	Audio analyzer (Panasonic VP-7723B)

## [Supply Voltage]

**+Vcc/-Vcc** : Power Supply for audio power amplifiers

Output 1 (10%/1kHz)	40W x 2 ch
Output 2 (0.4%/2Hz-20kHz)	25W x 2 ch
Recommended operating Vcc (60Ω)	±24V

**Stand-By Control (5V)** : Power Supply for Stand-By Control Input  
5V : Operation / 0V : Stand-by

## [Operation Guide]

- |                                  |  |
|----------------------------------|--|
| 1. Installation of the heat sink | Please refer to a thermal design tip for the amplifier.  |
| 2. Load Connection               | Connect the $RL=6\Omega$ (Non-inductive load)  |
| 3. Power Supply Connection       | Connect the +Vcc/-Vcc (Output off : 0V)  |
| 4. Stand-By Control Connection   | Stand-By Control = 0V . Stand-by   |
| 5. Input Connection              | Connect the Oscillator (Sine wave / Output resistance 600Ω)  |
| 6. Power Supply                  | The gain of the evaluation board is set in 30dB.<br>At first, supply DC voltage to +Vcc and -Vcc.<br>Next, Stand-By Control = 5V . Operation |

